

TEST REPORT

FOR: Acoustiblok

Sound Transmission Loss Test

RAL™-TL03-085

ON: Acoustiblok 16

Page 1 of 3

CONDUCTED: 14 March 2003

TEST METHOD

Unless otherwise designated, the measurements reported below were made with all facilities and procedures in explicit conformity with the ASTM Designations E90-02 and E413-87, as well as other pertinent standards. Riverbank Acoustical Laboratories has been accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) for this test procedure. A description of the measuring technique is available separately.

DESCRIPTION OF THE SPECIMEN

The test specimen was designated by the manufacturer as Acoustiblok 16. The overall dimensions of the specimen as measured were 1.22 m (48 in.) wide by 2.44 m (96 in.) high and 2.54 mm (0.1 in.) thick. The specimen was a 16 oz. per square foot vinyl barrier. The specimen was placed directly in the laboratory's 1.22 m (4 ft) by 2.44 m (8 ft) test opening and was sealed on the periphery (both sides) with a dense mastic.

The weight of the specimen as measured was 13.6 kg (30 lbs.), an average of 4.4 kg/m² (0.9 lbs/ft²). The transmission area used in the calculations was 3 m² (32 ft²). The source and receiving room temperatures at the time of the test were 24±1°C (75±2°F) and 59±1% relative humidity. The source and receive reverberation room volumes were 178 m³ (6,298 ft³) and 139 m³ (4,912 ft³), respectively.

This report shall not be reproduced except in full, without the written approval of RAL.

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.



ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.
THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES
OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.

RIVERBANK ACOUSTICAL LABORATORIES

1512 S. BATAVIA AVENUE
GENEVA, ILLINOIS 60134

Alion Science and Technology

630/232-0104
FOUNDED 1918 BY
WALLACE CLEMENT SABINE

TEST REPORT

Acoustiblok

RAL™-TL03-085

14 March 2003

Page 2 of 3

TEST RESULTS

Sound transmission loss values are tabulated at the eighteen standard frequencies. A graphic presentation of the data and additional information appear on the following pages. The precision of the TL test data is within the limits set by the ASTM Standard E90-02.

<u>FREQ.</u>	<u>T.L.</u>	<u>C.L.</u>	<u>DEF.</u>	<u>FREQ.</u>	<u>T.L.</u>	<u>C.L.</u>	<u>DEF.</u>
100	19	0.95		800	25	0.14	3
125	12	0.99		1000	26	0.18	3
160	14	0.59		1250	28	0.16	2
200	16	0.41		1600	30	0.15	
250	17	0.32	2	2000	31	0.08	
315	19	0.32	3	2500	33	0.14	
400	20	0.22	5	3150	34	0.09	
500	22	0.22	4	4000	36	0.10	
630	23	0.20	4	5000	38	0.08	

STC=26

ABBREVIATION INDEX

FREQ. = FREQUENCY, HERTZ, (cps)

T.L. = TRANSMISSION LOSS, dB

C.L. = UNCERTAINTY IN dB, FOR A 95% CONFIDENCE LIMIT

DEF. = DEFICIENCIES, dB<STC CONTOUR (SUM OF DEF = 26)

STC = SOUND TRANSMISSION CLASS

THIS ELECTRONIC COPY OF THIS REPORT IS PROVIDED AS A COURTESY BY THE
ISSUING LABORATORY FOR REFERENCE AND INFORMATIONAL PURPOSES ONLY

Tested by _____ Approved by _____

Dean Victor
Senior Experimentalist

David L. Moyer
Laboratory Manager

TO BE OFFICIALLY VALID, THIS DOCUMENT MUST CONTAIN ALL SIGNATURES INDICATED


This report shall not be reproduced except in full, without the written approval of RAL.

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.



ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.
THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES
OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.

TEST REPORT
SOUND TRANSMISSION REPORT
RAL-TL03-085

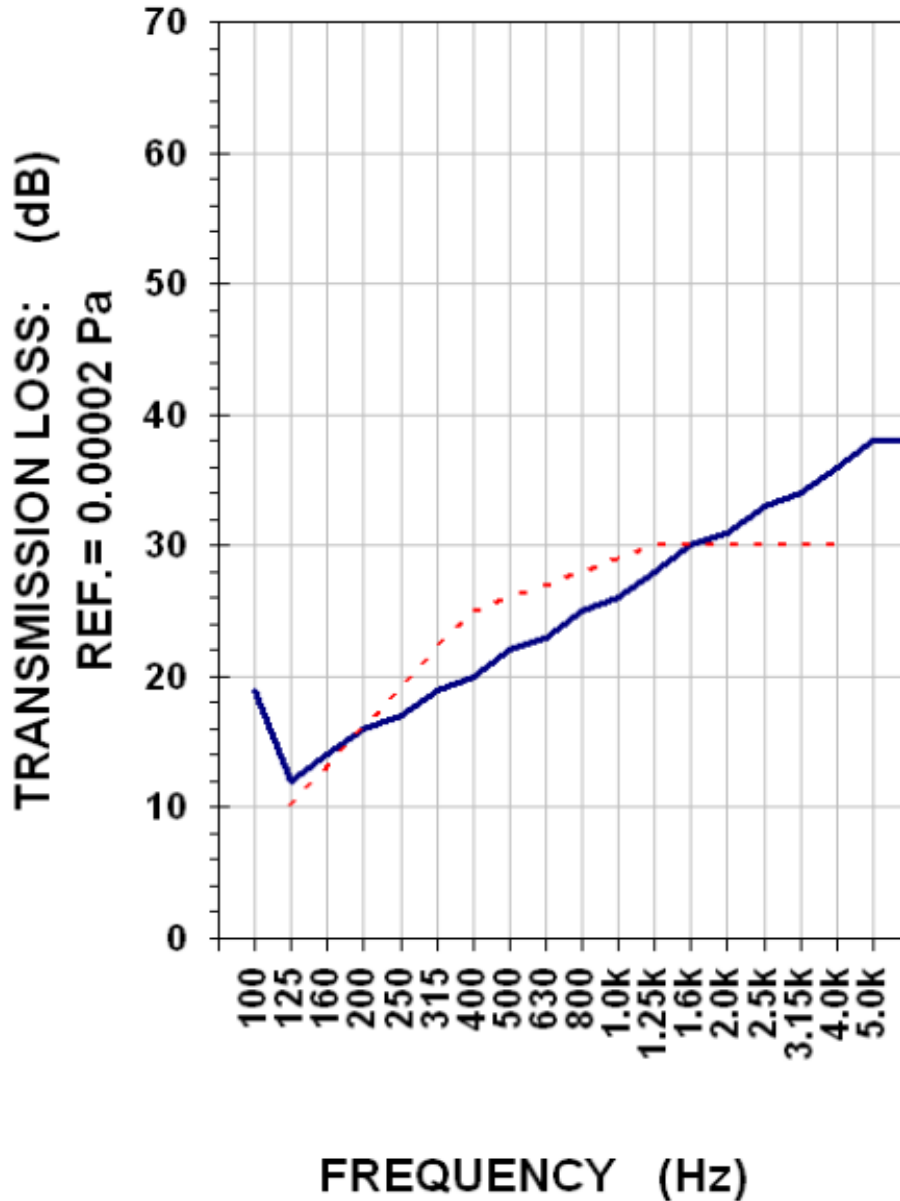

— TRANSMISSION LOSS
- - - SOUND TRANSMISSION CLASS CONTOUR

STC = 26

This report shall not be reproduced except in full, without the written approval of RAL.

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.



ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.
THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES
OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.